

PRESTANDADECLARATION

HECO-DoP_ETA_15/0784_MMS-plus_1606_SW

1. Produkttypens unika identifikationskod:

MULTI-MONTI-plus (MMS-plus)

2. Typ-, parti- eller serienummer eller någon annan beteckning som möjliggör identifiering av byggprodukter i enlighet med artikel 11.4:

Identifikation enligt ETA-15/0784 annex A2, A3

Partinummer: se produktens förpackning

3. Byggproduktens avsedda användning eller användningar i enlighet med den tillämpliga, harmoniserade tekniska specifikationen, såsom förutsett av tillverkaren:

ETA-15/0784 annex B1

Anchor type	Skruvankare
För användning i	<u>Betong C20/25 till C50/60 (EN 206)</u> - icke sprucken: Ø6, Ø7,5, Ø10 och Ø12 - sprucken: Ø6, Ø7,5, Ø10 och Ø12
Alternativ/kategori	<u>Alternativ 1</u> Seismisk: Prestandakategori C1
Laster	statisk, kvasistatisk, seismisk (Ø10 + Ø12), brandbelastning
Material/utförande	<u>Galvaniserat stål:</u> - för användning under torra förhållanden inomhus - olika huvudformer

4. Tillverkarens namn, registrerade företagsnamn eller registrerade varumärke samt kontaktadress enligt vad som krävs i artikel 11.5:

HECO-Schrauben GmbH & Co. KG

Dr.-Kurt-Steim-Str. 28

78713 Schramberg (Tyskland)

5. I tillämpliga fall namn och kontaktadress för tillverkarens representant vars mandat omfattar de uppgifter som anges i artikel 12.2: -

6. Systemet eller systemen för bedömning och fortlöpande kontroll av byggproduktens prestanda enligt bilaga V:

System 1

7. För det fall att prestandadeklarationen avser en byggprodukt som omfattas av en harmoniserad standard: -

8. För det fall att prestandadeklarationen avser en byggprodukt för vilken en europeisk teknisk bedömning har utfärdats:

- Bedömningsorgan: Deutsches Institut für Bautechnik (DIBt)
- Anmält organ: Otto-Graf-Institut Stuttgart, identifikationsnummer 0672
- Bedömningsdokument: ETAG 001 del 1, 3 (04.2013)
- Intyg om överensstämmelse: 0672-CPR-0635

9. Angiven prestanda

Väsentliga kännetecken	Beräkningsmetod	Effekt	Harmoniserade tekniska data
Karakteristiska värden för dragbrottsgräns	ETAG 001, annex: C, Metod A CEN/TS 1992-4:2009, Metod A	ETA-15/0784: annex C1	ETAG 001 Part 1, 3 ETAG 001, annex E EOTA TR 020 (brandmotstånd)
	EOTA TR 045	ETA-15/0784: annex C2	
	EOTA TR 020 (brandmotstånd) CEN/TS 1992-4: annex D	ETA-15/0784: annex C3	
Karakteristiska värden för tvärbrottsgräns	ETAG 001, annex: C, Metod A CEN/TS 1992-4:2009, Metod A	ETA-15/0784: annex C1	
	EOTA TR 045	ETA-15/0784: annex C2	
	EOTA TR 020 (brandmotstånd) CEN/TS 1992-4: annex D	ETA-15/0784: annex C3	
Monteringsparametrar		ETA-15/0784: annex B2	
Förskjutningar av gränstillstånd för brukbarhet	ETAG 001, annex: C, Metod A CEN/TS 1992-4:2009, Metod A	ETA-15/0784: annex C4	

10. Prestandan för den produkt som anges i punkterna 1 och 2 överensstämmer med den prestanda som anges i punkt 9. Denna prestandadeklaration utfärdas på eget ansvar av den tillverkare som anges under punkt 4.

Undertecknat för tillverkaren av:



Schramberg, 01.07.2016

i.V.

Andreas Hettich, Produkt- och marknadschef



Specifications of intended use

Use of the anchoring:

- Static and quasi static loads: all sizes.
- Seismic category C1:
 - MMS-plus all Versions, size 10 with maximum embedment depth (h_{nom2}) and size 12 with the embedment depth h_{nom1} and h_{nom2} .
- Fire exposure: all sizes.

Base Materials:

- Reinforced or non-reinforced normal weight concrete according to EN 206-1:2000.
- Strength classes C20/25 to C50/60 according to EN 206-1:2000.
- Non-cracked and cracked concrete: all sizes.

Conditions of use (Environmental conditions):

- Structures subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed for design method A in accordance with:
 - ETAG 001, Annex C, edition august 2010 or
 - CEN/TS 1992-4:2009
- The design of the anchoring under seismic action have to be carried out in accordance with:
 - EOTA Technical Report TR 045, edition February 2013
 - Anchoring's have to be placed outside of critical places like plastic hinges.
 - A distance mounting or mounting with mortar layer is not allowed.
- The design of the anchoring under fire exposure have to be carried in accordance with:
 - EOTA Technical Report 020, edition Mai 2014 or
 - CEN/TS 1992-4:2009, Annex D
 - In case of requirements for resistance of fire exposure it must be ensured that local spalling of the concrete cover does not occur.

Installation:


- Hole drilling by hammer-drilling only.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- The anchor may be used only once.
- After installation further turning of the anchor must not be possible.
- The head of the anchor must be supported on the fixture and is not damaged.

Annex B1



Table B1: Installation parameters MMS-plus

Size MMS-plus			6		7,5		10		12	
Embedment depth in concrete [mm]			h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
Nominal drill diameter d_0 [mm]			5		6		8		10	
Drill bit cutting diameter d_{cut} [mm]			5,40		6,40		8,45		10,45	
Depth of borehole h_1 [mm]			40	50	40	65	60	75	85	100
Diameter of clearance hole in the fixture d_f [mm]			7		9		12		14	
Diameter Countersunk d_h [mm]			11,5		15,5		19,5		24	
Min. thickness of the concrete member h_{min} [mm]			100	100	100	100	100	115	125	150
cracked and uncracked concrete min. spacing and min. edge distance s_{min} [mm]			30	30	40	40	40	50	60	60
Recommended installation tool [Nm]			Impact screw driver, max. power output T_{max} according manufacturer information							
Torque moment for threaded version (type MMS-plus V) T_{inst} [Nm]			-		15		20		30	

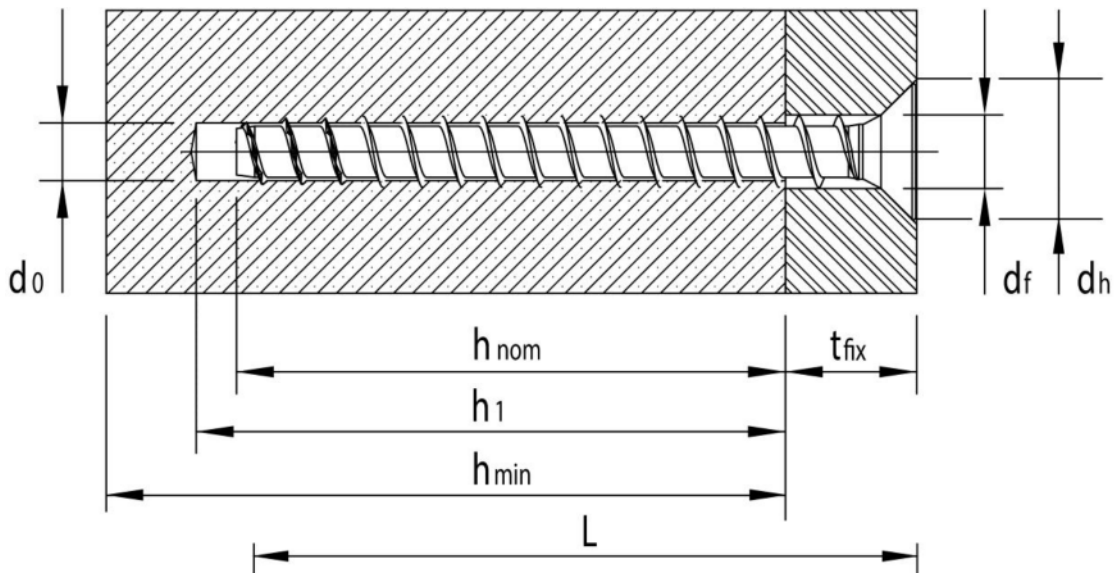

Annex B2

Table C1: Characteristic values for static and quasi-static tension MMS-plus

Size MMS-plus			6		7,5		10		12			
Embedment depth in concrete h_{nom} [mm]			h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}		
			35 ¹⁾	45	35 ¹⁾	55	50	65	75	90		
Steel failure for tension- and shear resistance												
Characteristic resistance	$N_{Rk,s}$	[kN]	10,8		17,6		32,1		49,9			
	$V_{Rk,s}$	[kN]	4,1		6,1		13,7		24,1			
	$k_2^{2)}$	-	0,8									
	$M_{Rk,s}^0$	[Nm]	6,7		14,1		34,5		66,8			
Partial safety factor		γ_2	1,25									
Pullout												
Characteristic resistance in uncracked concrete C20/25		$N_{Rk,p}$	[kN]	4,0	6,0	4,0	9,0	12,0	16,0	20,0	25,0	
Characteristic resistance in cracked concrete C20/25		$N_{Rk,p}$	[kN]	1,0	1,5	2,0	4,0	6,0	9,0	12,0	16,0	
Increasing factor for concrete	C30/37	ψ_c	-	1,22								
	C40/50			1,41								
	C50/60			1,55								
Concrete cone failure and splitting failure												
Effective anchorage depth		h_{ef}	[mm]	26	35	26	43	36	50	57	70	
Factor for	cracked	$k_{cr}^{2)}$	-	7,2								
	uncracked	$k_{unc}^{2)}$	-	10,1								
Concrete cone	edge distance	$c_{cr,N}$	[mm]	1.5 h_{ef}								
	spacing	$s_{cr,N}$	[mm]	3 h_{ef}								
Splitting	edge distance	$c_{cr,sp}$	[mm]	1.8 h_{ef}								
	spacing	$s_{cr,sp}$	[mm]	3.6 h_{ef}								
Installation safety factor		$\gamma_2^{3)} = \gamma_{inst}^{2)}$	-	1,0								
Concrete pryout failure												
k-factor		$k^{3)} = K_3^{2)}$	-	1,0								2,0
Concrete edge failure												
Effective length of the anchor under shear loading		$l_{ef} = h_{ef}$	[mm]	26	35	26	43	36	50	57	70	
Effective diameter of the anchor		d_{nom}	[mm]	5		6		8		10		

¹⁾ Only for non-structural applications

²⁾ Parameter only relevant for the design according to CEN/TS 1992-4:2009

³⁾ Parameter only relevant for the design according to ETAG 001, Annex C



Table C2: Characteristic values for seismic actions C1

Size MMS-plus			10	12	
Embedment depth in concrete [mm]	h_{nom}		h_{nom2}	h_{nom1}	h_{nom2}
			65	75	90
Steel failure for tension- and shear resistance					
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	24,1	37,4	
	$V_{Rk,s,seis}$	[kN]	9,6	16,9	
Pullout					
Characteristic in cracked concrete	$N_{Rk,p,seis}$	[kN]	6,8	9,0	12,0
Concrete cone failure					
Effective anchorage depth	h_{ef}	[mm]	50	57	70
concrete edge distance	$c_{cr,N}$	[mm]	1,5 h_{ef}		
cone spacing	$s_{cr,N}$	[mm]	3 h_{ef}		
Installation safety factor	γ_2	-	1,0		
Concrete pryout failure					
k-factor	k	-	2,0	1,0	
Concrete edge failure					
Effective length of the anchor under shear loading	$l_{ef} = h_{ef}$	[mm]	50	57	70
Effective diameter of the anchor	d_{nom}	[mm]	8	10	

Annex C2





Table C3: Characteristic values under fire exposure

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete h_{nom} [mm]				h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
				35	45	35	55	50	65	75	90
Steel failure for tension- and shear resistance ($F_{Rk,fi} = N_{Rk,fi} = V_{Rk,fi}$)											
Characteristic resistance	R30	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	1,0	1,5	2,3	3,0	3,0
	R60	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,8	1,4	1,4	2,1	2,1
	R90	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,5	1,0	1,0	1,5	1,5
	R120	$F_{Rk,fi}$	[kN]	0,2	0,3	0,4	0,4	0,8	0,8	1,2	1,2
	R30	$M^0_{Rk,s,fi}$	[Nm]	0,5		1,1		2,7		5,3	
	R60	$M^0_{Rk,s,fi}$	[Nm]	0,3		0,6		1,5		2,8	
	R90	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,4		1,1		2,0	
	R120	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,3		0,9		1,6	
Edge distance											
R30 to R120		$C_{cr,fi}$	[mm]	2 h_{ef}							
Spacing											
R30 to R120		$S_{cr,fi}$	[mm]	2 $C_{cr,fi}$							

Annex C3



Table C4: Displacements under tension loads

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		h_{nom}	[mm]	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
				35	45	35	55	50	65	75	90
Cracked concrete C20/25 to C50/60	tension	N	[kN]	1,9	3,0	1,9	5,3	5,7	7,9	10,7	12,8
	displacement	δ_{N0}	[mm]	0,11	0,11	0,06	0,12	0,06	0,07	0,05	0,19
		$\delta_{N\infty}$	[mm]	0,30	0,28	0,38	1,03	0,75	0,72	0,74	0,60
Uncracked concrete C20/25 to C50/60	tension	N	[kN]	0,5	0,7	0,9	2,0	2,9	4,3	5,7	6,4
	displacement	δ_{N0}	[mm]	0,01	0,02	0,03	0,04	0,03	0,09	0,05	0,02
		$\delta_{N\infty}$	[mm]	0,14	0,09	0,12	0,11	0,08	0,09	0,07	0,22

Table C5: Displacements under shear loads

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		h_{nom}	[mm]	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
				35	45	35	55	50	65	75	90
Cracked and uncracked concrete C20/25 to C50/60	shear load	V	[kN]	2	2	4	4	8	8	12	12
	displacement	δ_{N0}	[mm]	0,14	0,13	0,09	0,11	0,18	0,13	0,18	0,18
		$\delta_{N\infty}$	[mm]	0,20	0,19	0,13	0,16	0,27	0,20	0,27	0,27